


TYPICAL RESIDENTIAL OVERHEAD INSTALLATION

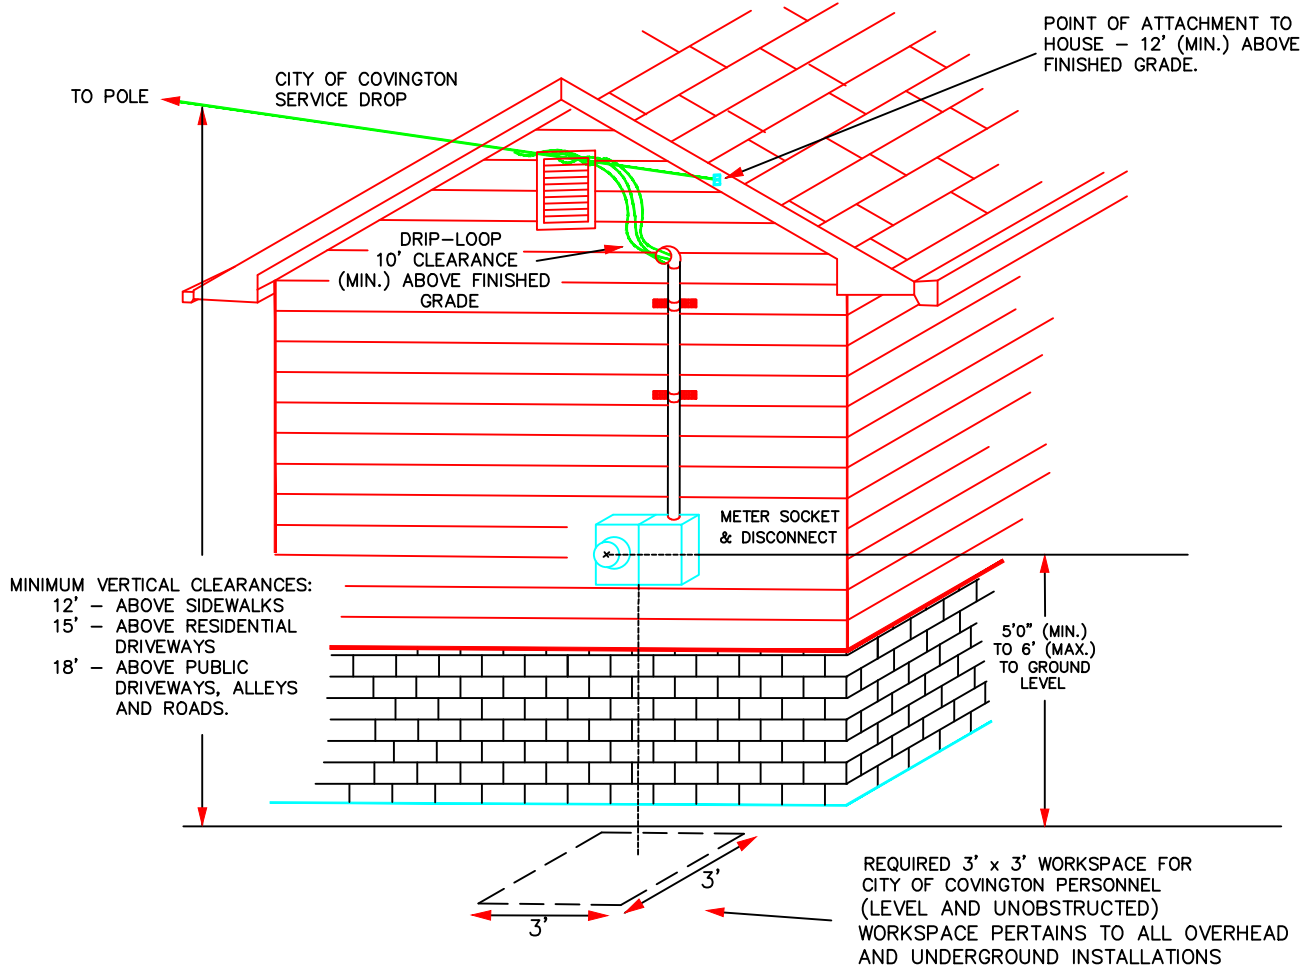

A. GENERAL NOTES

- OVERHEAD SERVICE DROP AND METER PROVIDED AND INSTALLED BY THE CITY OF COVINGTON
- CLEARANCES MUST BE PROVIDED AS SHOWN ABOVE.

B. MOUNTING OF METER SOCKET

- UNIT SHALL BE SURFACE MOUNTED, WITH CENTER OF UNIT BETWEEN 5'0" AND 6'0" ABOVE FINAL GRADE, IN A LEVEL AND PLUMB POSITION.
- UNIT SHALL BE FASTENED TO BUILDING SECURELY USING LEAD ANCHORS (FOR BRICK AND CONCRETE), TOGGLE BOLTS (FOR WOOD SIDING) OR WOOD SCREWS (FOR 2"x4" STUDS, LOG WALLS, OR OTHER SOLID LUMBER). ALL SCREWS OR BOLTS SHALL BE 1/4" DIAMETER (MIN.) STAINLESS STEEL. A MINIMUM OF FOUR FASTENERS SHALL BE USED TO MOUNT SOCKET.

C. SERVICE DROP ATTACHMENT

- DEVICE FOR ATTACHING SERVICE DROP TO BUILDING SHALL BE FURNISHED AND INSTALLED SECURELY BY CUSTOMER AT MINIMUM VERTICAL CLEARANCE AS SHOWN BELOW.
- IF MINIMUM VERTICAL CLEARANCE CANNOT BE MAINTAINED WITH THE INSTALLATION OF AN ATTACHMENT BOLT AS SHOWN BELOW, THE CUSTOMER SHALL INSTALL A STEEL SERVICE MAST.
- NEW METER LOCATIONS SHALL BE APPROVED BY THE CITY OF COVINGTON

IT SHALL BE THE CUSTOMER'S RESPONSIBILITY FOR COMPLIANCE WITH THE NATIONAL ELECTRICAL CODE (NEC)



CITY OF COVINGTON

NEWTON COUNTY, GEORGIA

DATE: JANUARY 1, 2016

©2016
CITY OF COVINGTON
ALL RIGHTS RESERVED