


# TEMPORARY SERVICE STRUCTURE – UNDERGROUND RESIDENTIAL


## SERVICE POST INSTALLATION

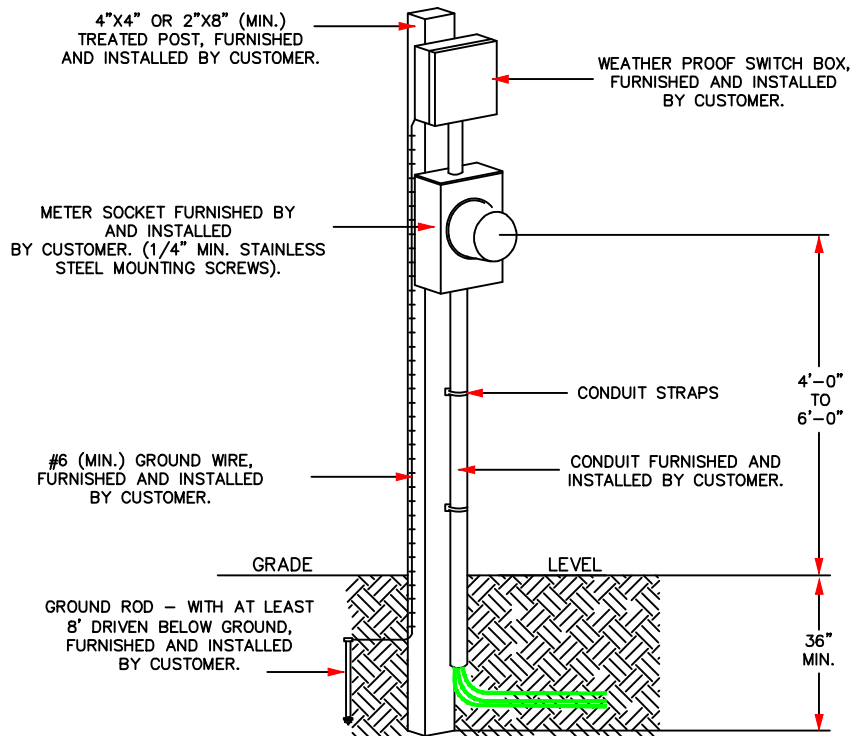

### NOTES:


- TREATED WOOD SERVICE STRUCTURE RATED FOR IN GROUND USE, 4" X 4" OR 2" X 8" MIN.
- SERVICE CABLE AND CONDUIT ACCORDING TO NEC.
- SERVICE EQUIPMENT TO INCLUDE GFCI RECEPTACLES.
- GROUND ROD ACCORDING TO NEC. (NO. 6 MINIMUM COPPER GROUNDING CONDUCTOR)
- LENGTH OF SERVICE CABLE LEFT ABOVE GROUND SHALL BE EQUAL TO THE DISTANCE BETWEEN POST AND ELECTRICAL SOURCE, PLUS 10'

### TYPICAL LOCATIONS

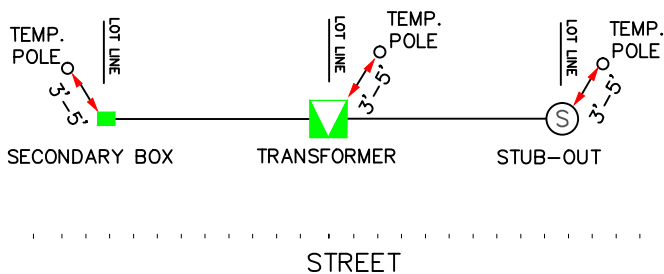

### CONDUIT STUB-OUT

TEMP. METERBASE TO BE PLACED 3'-5' FROM CONDUIT STUB-OUT, WITH WIRE BURIED AND ROUTED TO TERMINATE ADJACENT TO CONDUIT STUB-OUT (MAX. 1' BETWEEN STUB-OUT AND WIRE)

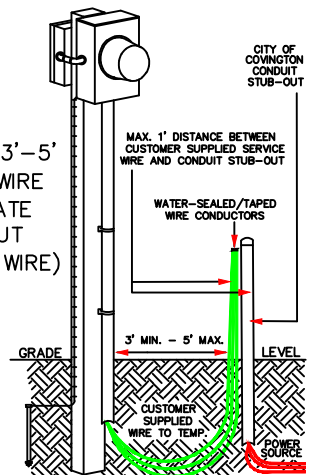

# CITY OF COVINGTON

NEWTON COUNTY, GEORGIA

DATE: JANUARY 1, 2016

© 2016  
CITY OF COVINGTON  
ALL RIGHTS RESERVED